

Report # K-419995-11-R00

Samples Received:
Sep-07-17

Samples Tested:
Sep-08-17

Test Report

Kinectrics Inc., 800 Kipling Avenue, Unit 2
Toronto, Ontario, Canada
Tel: 416-207-6000, www.kinectrics.com



Tested for

Oberon
22 Logan Street
New Bedford, MA, 02740-7324
USA

Contact information for item tested:

Oberon
Jack Hirschmann
JHirschmann@oberoncompany.com
508-789-8983

Test item description

Oberon Company, Hood, True Color Grey 40;
Lens: Polycarbonate G2 Window, Grey;
Hard Hat: Oberon HC6P-WHT ABS Hard Cap, Type 1, Class C, G & E;
Fabric: (L1) Style 1016; Blend: 60% Para-Aramid, 40% Meta-Aramid; Color: Black; Weave/Knit: Twill; Nominal Weight: 5.0 oz/yd²; Weight as Tested: 5.4 oz/yd²; (L2/L3) Style 995Q; Blend: 51% Meta-Aramid, 49% Para-Aramid, Weave/Knit: Non-Woven quilted to twill, Color: Yellow; Nominal Weight: 5.7 oz/yd²; Weight as Tested: 10.4 oz/yd²;

FABRIC ARC RATING: ATPV = 46 cal/cm² Kinectrics Report K-419995-01-R00 August 28, 2017

Reference Standard

ASTM F2178-17
Standard Test Method for Determining the Arc Rating and Standard Specification for Eye or Face Protective Products

Test Parameters:

Test current: 8 kA	Number of samples analysed: 20
Arc Gap: 30 cm	
Distance to Fabric: 30 cm	Incident Energy Range: 67 to 93 cal/cm ²

Hood System Arc Rating, ATPV = 46 Cal/cm²

Heat Attenuation Factor, HAF = 97%

During testing the hood system received an arc rating that far exceeded the arc rating assigned to the hood fabric. As a result, the hood system arc rating was assigned the arc rating of the value of the base hood fabric. No variations to standard method noted. Samples tested as received, samples not laundered.

Test Summary

The Arc Rating of this material is intended for use as part of a flame resistant garment or system for workers exposed to electric arcs. The test result is applicable only to the test item as described; other fiber blends, weaves, finishing or dye may have different protection level. The test articles are tested as received; no test is done to validate the fiber content or composition. The Arc Rating was calculated based on the data obtained and analysed in accordance with the latest version of the applicable standards. The individual test sheets, graphs, photographs of the samples and video of every test are provided in digital format to the Client for review.

The arc testing performed to the above mentioned Standard is accredited by the Standards Council of Canada (SCC) to conform to the requirements of CAN-P-4E (ISO/IEC 17025:2005). Accreditation by the Standards Council of Canada (SCC) is a mark of competence and reliability recognized throughout the world.

Kinectrics Inc takes reasonable steps to ensure that all work performed shall meet the industry standards as set out in Kinectrics Inc.'s Quality Manual, and that all reports shall be reasonably free of errors, inaccuracies or omissions. KINETRICS INC. DOES NOT MAKE ANY WARRANTY OR REPRESENTATION WHATSOEVER, EXPRESS OR IMPLIED, WITH RESPECT TO THE MERCHANTABILITY OR FITNESS FOR ANY PARTICULAR PURPOSE OF ANY INFORMATION CONTAINED IN THIS REPORT OR THE RESPECTIVE WORKS OR SERVICES SUPPLIED OR PERFORMED BY KINETRICS INC. Kinectrics Inc. does not accept any liability for any damages, either directly, consequentially or otherwise resulting from the use of this report.

Note: The test performed does not apply to electrical contact or electrical shock hazard.

©Kinectrics. Partial reproduction of this report is strictly prohibited without the express written consent of Kinectrics Inc.

Prepared by:

Approved by:

Daniel Ferguson
HCL Lead Technologist
Kinectrics Inc.

Andrew Haines
HCL Supervising Technologist
Kinectrics Inc.

Note: For verification about results in this report, please forward copy of the report or inquiry to hcl@kinectrics.com

Date:
Sep-08-17

Determination of ATPV by performing logistic regression on the panel burn response as indicated in Summary Table




Report #
K-419995-11-R00

Test Performed in accordance with: ASTM F2178-17

Fabric Description:

Oberon Company, Hood, True Color Grey 40;
 Lens: Polycarbonate G2 Window, Grey;
 Hard Hat: Oberon HC6P-WHT ABS Hard Cap, Type 1, Class C, G & E;
 Fabric: (L1) Style 1016; Blend: 60% Para-Aramid, 40% Meta-Aramid; Color: Black; Weave/Knit: Twill; Nominal Weight: 5.0 oz/yd²; Weight as Tested: 5.4 oz/yd²; (L2/L3) Style 995Q; Blend: 51% Meta-Aramid, 49% Para-Aramid, Weave/Knit: Non-Woven quilted to twill, Color: Yellow; Nominal Weight: 5.7 oz/yd²; Weight as Tested: 10.4 oz/yd²;

Hood System Limited by Fabric Arc Rating, ATPV = 46 cal/cm²

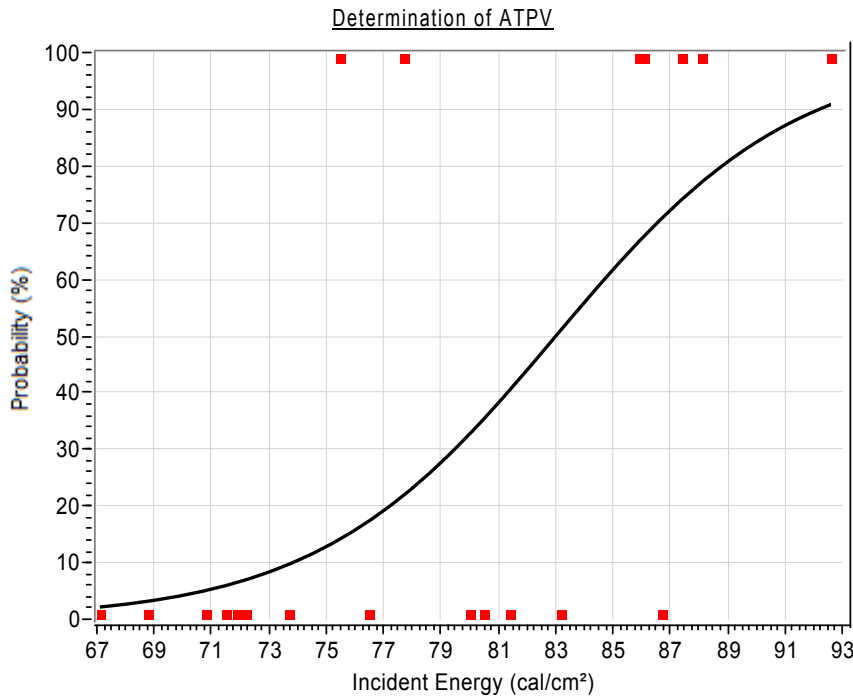


ATPV = 83 cal/cm²

Probability	Ei
5%	70.7
10%	73.8
20%	77.2
30%	79.5
40%	81.3
50%	83.0
60%	84.7
70%	86.6
80%	88.8
90%	92.2


(Note: ATPV is reported to nearest integer for ratings above 10 cal/cm²)

Total points analyzed = 20
Points above Stoll = 7
Points above mix zone = 3
Points below mix zone = 7
Pts within 20% = 20
Pts in mix zone = 10

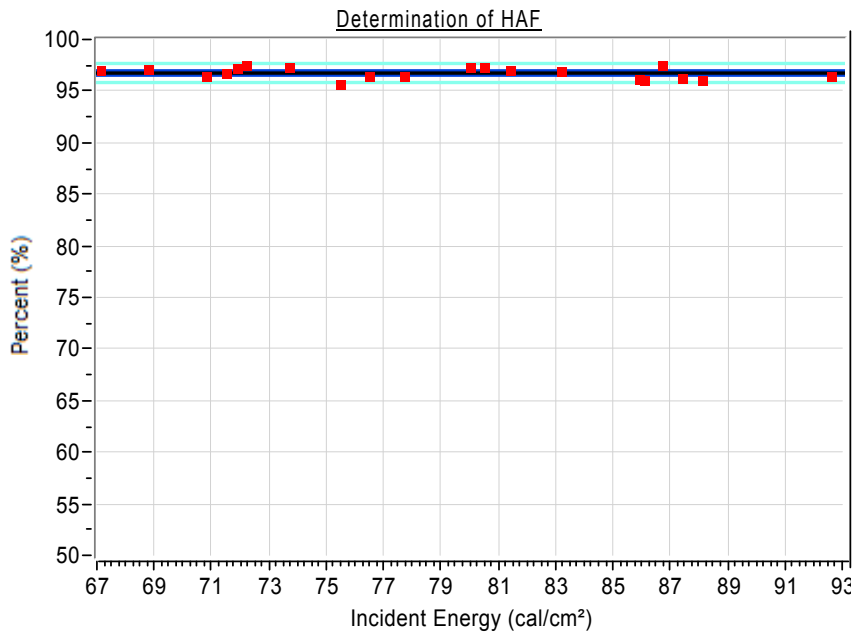

HAF = 97 %

Confidence Intervals
 95% CI = 96.8 , 97.2



Date:
Sep-08-17

Summary of Measured Energy and Observations



Report #
K-419995-11-R00

Test Performed in accordance with : ASTM F2178-17

Fabric Description: Oberon Company, Hood, True Color Grey 40;
 Lens: Polycarbonate G2 Window, Grey;
 Hard Hat: Oberon HC6P-WHT ABS Hard Cap, Type 1, Class C, G & E;
 Fabric: (L1) Style 1016; Blend: 60% Para-Aramid, 40% Meta-Aramid; Color: Black;
 Weave/Knit: Twill; Nominal Weight: 5.0 oz/yd²; Weight as Tested: 5.4 oz/yd²;
 Manufacturer: InsulSAFE; (L2/L3) Style 995Q; Blend: 51% Meta-Aramid, 49% Para-Aramid, Weave/Knit: Non-Woven quilted to twill, Color: Yellow; Nominal Weight: 5.7 oz/yd²; Weight as Tested: 10.4 oz/yd²;
 Manufacturer: InsulSAFE/DuPont/Oberon;

	Test #	Panel	Test Current A	Cycles of 60Hz	Ei Cal/cm ²	SCD Cal/cm ²	HAF %	>Stoll Y/N	Break Open Y/N	Ablation Y/N	After Flame sec.	Omit Y/N	Comment
1	K-419995-5209	A	7994	90.3	71.9	-0.3	97.2	No	-	-	3	No	
2	K-419995-5209	B	7994	90.3	72.2	-0.3	97.5	No	-	-	2.5	No	
3	K-419995-5210	A	7989	105.3	75.5	0.9	95.7	Yes	-	-	3	No	Exceeded Stoll curve on MO and CH sensors
4	K-419995-5210	B	7989	105.3	87.4	0.6	96.3	Yes	-	-	3	No	Exceeded Stoll curve on MO sensor
5	K-419995-5211	A	7998	105.3	85.9	0.5	96.2	Yes	-	-	5	No	Exceeded Stoll on CH sensor
6	K-419995-5211	B	7998	105.3	83.2	-0.1	96.9	No	-	-	7	No	
7	K-419995-5212	A	8005	100.4	71.5	-0.1	96.7	No	-	-	4.5	No	
8	K-419995-5212	B	8005	100.4	80.0	-0.1	97.3	No	-	-	3	No	
9	K-419995-5213	A	8016	110.2	92.6	0.4	96.4	Yes	-	-	6	No	Exceeded Stoll curve on CH sensor
10	K-419995-5213	B	8016	110.2	76.5	-0.1	96.4	No	-	-	9	No	
11	K-419995-5214	A	8018	90.3	68.8	-0.3	97.1	No	-	-	2.5	No	
12	K-419995-5214	B	8018	90.3	70.8	-0.1	96.4	No	-	-	4	No	
13	K-419995-5215	A	8016	106.2	77.7	0.1	96.5	Yes	-	-	12	No	Exceeded Stoll curve on RE sensor
14	K-419995-5215	B	8016	106.2	88.1	0.4	96.1	Yes	-	-	9.5	No	Exceeded Stoll curve on CH sensor
15	K-419995-5216	A	8052	101.4	80.5	-0.2	97.3	No	-	-	3.5	No	
16	K-419995-5216	B	8052	101.4	86.7	-0.3	97.5	No	-	-	18.5	No	
17	K-419995-5217	A	8044	89.3	67.1	-0.3	97.0	No	-	-	3	No	
18	K-419995-5217	B	8044	89.3	73.7	-0.4	97.3	No	-	-	3	No	
19	K-419995-5218	A	8038	102.3	86.1	0.6	96.1	Yes	-	-	7.5	No	Exceeded Stoll curve on CH sensor
20	K-419995-5218	B	8038	102.3	81.4	-0.2	97.0	No	-	-	3	No	
21													
22													
23													
24													
25													
26													
27													
28													
29													
30													
31													
32													
33													
34													
35													
36													
37													
--													

20 samples exhibited afterflame during testing with an average duration of 5.6 seconds. No evidence of breakopen, melting, dripping or ignition of any of the samples tested.